

KNOX ELEVATOR BOX™

MOUNTING INSTRUCTIONS




GENERAL MOUNTING INSTRUCTIONS

- CAUTION!** Be extremely careful when handling the Knox Elevator Box prior to installation. When not mounted, the door will be OPEN. Always hold box and door securely to prevent door closing on fingers and causing injury.

Tamper Alert: If your Knox Elevator Box has the Tamper Alert feature, remove the Tamper Alert assembly and set aside for installation after the box is mounted.
- Always mount your Knox Elevator Box to a secure solid wall. A six (6) foot height level is recommended to resist vandalism. The Knox Elevator Box should never be mounted with the door facing up or down.
- Use a small level to plumb the box square.
- Use at least four (4) mounting fasteners (Grade 5 or equivalent bolts and nuts, etc.) 5/16" diameter.

WARNING! Do not mount box to an extremely rough or uneven wall surface. This may distort the box and cause the door to malfunction.

- For proper security, bolts should go through a solid wall with large backup washers on the opposite side.
- We strongly recommend that all Tamper Alert connections and adjustments be carried out by a qualified alarm technician.

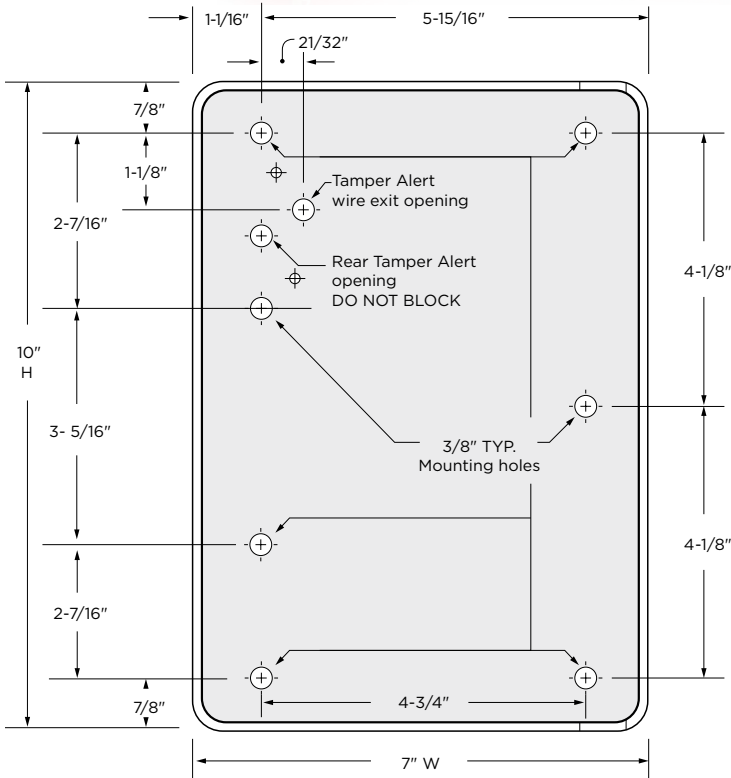

Mounting Hole Diagram

NOTE:
Suggested minimum mounting height: 6' above ground

ATTENTION:
Installation of this product should be performed only by individuals skilled in the use of the tools and equipment necessary for installation. If you have any doubt concerning your competence or expertise, consult a qualified expert to perform the installation.



All Knox Elevator Boxes are fully tested and listed by Underwriters Laboratories as anti-theft devices. Alarm Tamper Alert switches are UL listed as Central Station Alarm Units. UL Electrical Range: Max Voltage of 24 VDC at 50 mA.

- | | |
|---------|-----------------------------------|
| UL 437 | Standard for Safety for Key Locks |
| UL 1037 | Antitheft Alarms and Devices |
| UL 1610 | Central Station Alarm Units |

MOUNTING THE KNOX ELEVATOR BOX

Knox Elevator Boxes have seven (7) pre-drilled mounting holes in the back side, each 3/8" in diameter. Outside dimensions of the unit are 7" W x 10" H x 2" D; the door swings 7" to the right.

When mounting the Knox Elevator Box to wall, check to see that the circuit is activated and that the rear "Box to Wall" Tamper Alert plunger is depressed with at least 1/8" overtravel. The Tamper Alert is rated at 24 VDC @ 50 mA.

Two (2) holes in the front lock dust cover enable it to accept a numbered security seal to indicate when the lock cover has been opened.


Each time the front lock cover is opened, the seal is broken and a new seal must be inserted. Standard security precautions will require that persons opening the box sign their name in a log book inside the cabinet, indicating the number of the old and the new seal. Seals may be obtained from the Knox Company.

BOX LOCKUP:

When mounting of the Knox Elevator Box is complete, contact your local fire department to inform them the box is ready for lock up. **They have the only key to lock the box.**

For private, industrial or commercial use:


Keys will be sent separately to address requested.

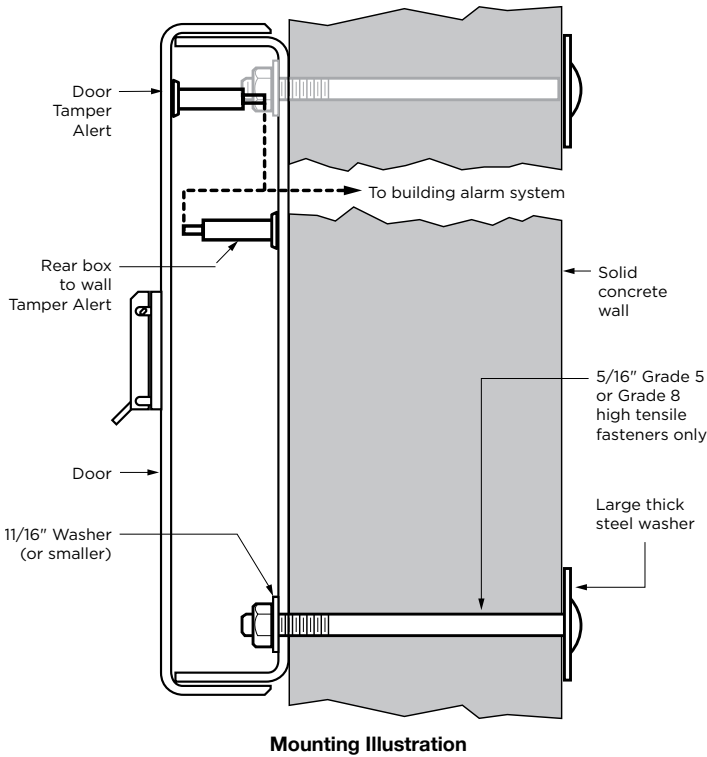

Mounting Illustration

1601 W. DEER VALLEY ROAD, PHOENIX, AZ 85027 | T. 800-552-5669 | F. 623-687-2290 | INFO@KNOXBOX.COM | KNOXBOX.COM

Expansion Panel Mounting Illustration

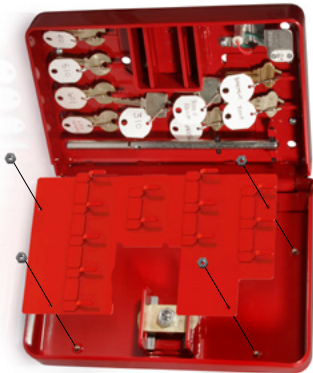

OPTIONAL EXPANSION PANEL INSTRUCTIONS

Key Hook Expansion Panel

Your Knox Elevator Box comes standard with nine (9) key hooks. For extra key storage capacity, this 13 hook expansion panel can be mounted to the interior right-hand side of the box.

Expansion Panel Mounting Instructions

Using a 9 mm socket wrench or similar tool and the four (4) 8-32 keps lock nuts included, install the Key Hook Expansion Panel onto the mounting studs provided on the right-hand interior of the box.



KNOX
When seconds matter™



KNOX
ELEVATOR BOX™
MOUNTING INSTRUCTIONS



KNOX
When seconds matter™

KNOX
ELEVATOR BOX™
MOUNTING INSTRUCTIONS